



Sample Description : WPC HOLLOW DECKING  
 Style / Item No. : YT-140H24  
 Sample Receiving Date : Jul.25, 2018  
 Test Performing Date : Jul.25, 2018 to Aug.06, 2018

**Test Result Summary**

Test(s) Requested	Result(s)
EN 13501-1:2007+A1:2009 Fire classification of construction products and building elements-Part 1: Classification using data from reaction to fire tests	Classification: B <sub>fl</sub> -s1

**Summary:**

1. For further details, please refer to the following page(s).

Signed for and on behalf of  
 Shunde Branch  
 SGS-CSTC Co., Ltd.

Kevin Pan  
 Approved signatory



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

## TESTS AND RESULTS

### Test Conducted:

This test is conducted as per EN 13501-1:2007+A1:2009 Fire classification of construction products and building elements-Part 1: Classification using data from reaction to fire tests.

And the test methods as following:

1. EN ISO 9239-1:2010 Reaction to fire tests for floorings-Part 1: Determination of the burning behaviour using a radiant heat source.
2. EN ISO 11925-2:2010+AC:2011 Reaction to fire tests-Ignitability of building products subjected to direct impingement of flame-Part 2: Single-flame source test.

### Mounting and fixing (For EN ISO 9239-1:2010):

Fibre cement board, with its density about 1800kg/m<sup>3</sup>, thickness about 8mm, is as the substrate.

Specimen width less than 230 mm, joining together two pieces of samples to 230 mm wide. Spelling a seam in the middle of the 230 mm width position.

### Test Results:

Test method	Parameter	Number of tests	Results
EN ISO 9239-1:2010	The mean value for the critical heat flux (CHF and/or HF-30) from the same orientation	3	≥11kW/m <sup>2</sup>
	Smoking measurement Integrated smoke value		73.3%×min
	Comments and Observation		Charring
EN ISO 11925-2:2010+AC:2011 Exposure = 15 s	F <sub>s</sub> ≤ 150 mm within 20 s	12	Yes

Remark:

- 1). Specimens that do not ignite or which spread flame less than 110 mm have a critical heat flux ≥ 11kW/m<sup>2</sup>
- 2). Above value is the mean value for the critical flux (CHF and/or HF-30) from the three same orientation specimens.



**Classification and direct field of application**

This classification has been carried out in accordance with **EN 13501-1:2007+A1:2009**.

**Classification:**

Fire behaviour		Smoke production	
B <sub>fl</sub>	—	s	1

**Remark:**

The classes with their corresponding fire performance are given in Table 2.

Reaction to fire classification is based on the 7-step scale of A<sub>1fl</sub> to F<sub>fl</sub>, where A<sub>1fl</sub> is good and F<sub>fl</sub> is bad.

**Statement:**

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.

**Warning:**

This classification report does not represent type approval or certification of the product.

The test laboratory has, therefore, play no part in sampling the product for the test, although it holds appropriate references to the manufacturer's factory production control that is aimed to be relevant to the samples tested and that will provide for their traceability.



SGS-CSTC Standards Technical Services Co., Ltd.  
Shunde Branch Harbin

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

1/F, 1<sup>st</sup> Building European Industrial Park, No.1 Shunde South Road, Wusha Section, Daliang Town, Shunde, Foshan, Guangdong, China 528333 t (86-757)22805888 f (86-757)22805858 www.sgsgroup.com.cn  
中国·广东·佛山市顺德区大良街道办事处五沙顺和南路1号欧洲工业园一号厂房首层 邮编: 528333 t (86-757)22805888 f (86-757)22805858 e [sgs.china@sgs.com](mailto:sgs.china@sgs.com)

Table 2-Classes of reaction to fire performance for floorings

Class	Test method(s)	Classification criteria	Additional classification
A1 <sub>fl</sub>	EN ISO 1182 <sup>a</sup> and	$\Delta T \leq 30$ °C; and $\Delta m \leq 50$ %; and $t_f = 0$ (i.e. no sustained flaming)	-
	EN ISO 1716	$PCS \leq 2,0$ MJ/kg <sup>a</sup> and $PCS \leq 2,0$ MJ/kg <sup>b</sup> and $PCS \leq 1,4$ MJ/m <sup>2</sup> <sup>c</sup> and $PCS \leq 2,0$ MJ/kg <sup>d</sup>	-
A2 <sub>fl</sub>	EN ISO 1182 <sup>a</sup> or	$\Delta T \leq 50$ °C and $\Delta m \leq 50$ % and $t_f \leq 20$ s	-
	EN ISO 1716 and	$PCS \leq 3,0$ MJ/kg <sup>a</sup> and $PCS \leq 4,0$ MJ/m <sup>2</sup> <sup>b</sup> and $PCS \leq 4,0$ MJ/m <sup>2</sup> <sup>c</sup> and $PCS \leq 3,0$ MJ/kg <sup>d</sup>	-
	EN ISO 9239-1 <sup>e</sup>	Critical flux <sup>f</sup> $\geq 8,0$ kW/m <sup>2</sup>	Smoke production <sup>g</sup>
B <sub>fl</sub>	EN ISO 9239-1 <sup>e</sup> and	Critical flux <sup>f</sup> $\geq 8,0$ kW/m <sup>2</sup>	Smoke production <sup>g</sup>
	EN ISO 11925-2 <sup>h</sup> : Exposure = 15 s	$F_s \leq 150$ mm within 20 s	-
C <sub>fl</sub>	EN ISO 9239-1 <sup>e</sup> and	Critical flux <sup>f</sup> $\geq 4,5$ kW/m <sup>2</sup>	Smoke production <sup>g</sup>
	EN ISO 11925-2 <sup>h</sup> : Exposure = 15 s	$F_s \leq 150$ mm within 20 s	
D <sub>fl</sub>	EN ISO 9239-1 <sup>e</sup> and	Critical flux <sup>f</sup> $\geq 3,0$ kW/m <sup>2</sup>	Smoke production <sup>g</sup>
	EN ISO 11925-2 <sup>h</sup> : Exposure = 15 s	$F_s \leq 150$ mm within 20 s	
E <sub>fl</sub>	EN ISO 11925-2 <sup>h</sup> : Exposure = 15 s	$F_s \leq 150$ mm within 20 s	
F <sub>fl</sub>	No performance determined		

<sup>a</sup> For homogeneous products and substantial components of non-homogeneous products.  
<sup>b</sup> For any external non-substantial component of non-homogeneous products.  
<sup>c</sup> For any internal non-substantial component of non-homogeneous products.  
<sup>d</sup> For the product as a whole.  
<sup>e</sup> Test duration = 30 min.  
<sup>f</sup> Critical flux is defined as the radiant flux at which the flame extinguishes or the radiant flux after a test period of 30 min, whichever is the lower (i.e. the flux corresponding with the furthest extent of spread of flame).  
<sup>g</sup> **s1** = Smoke  $\leq 750$  % minutes;  
**s2** = not s1.  
<sup>h</sup> Under conditions of surface flame attack and, if appropriate to the end use application of the product, edge flame attack




Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.


Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

**SAMPLE INFORMATION AND PICTURES**

Thickness: About 23mm  
Mass per unit area: About 20.1kg/m<sup>2</sup>

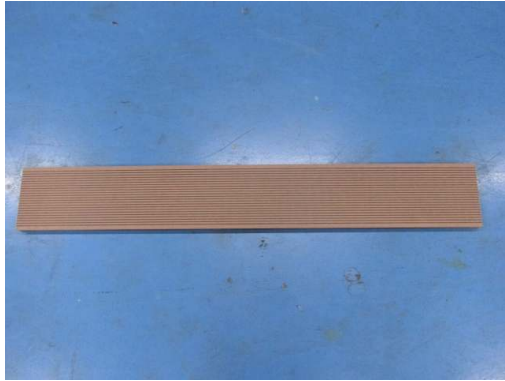

Sample face

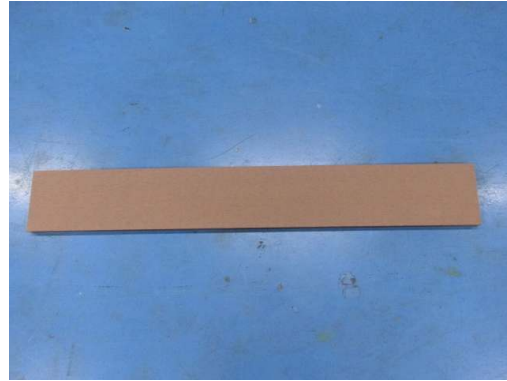

Sample back

\*\*\*End of Report\*\*\*



SGS-CSTC Standards Technical Services Co., Ltd.  
Shunde Branch Harbin

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

1/F, 1<sup>st</sup> Building European Industrial Park, No.1 Shunde South Road, Wusha Section, Daliang Town, Shunde, Foshan, Guangdong, China 528333 t (86-757)22805888 f (86-757)22805858 www.sgs.com.cn  
中国·广东·佛山市顺德区大良街道办事处五沙顺和南路1号欧洲工业园一号楼首层 邮编: 528333 t (86-757)22805888 f (86-757)22805858 e [sgs.china@sgs.com](mailto:sgs.china@sgs.com)